

**GENERAL INFORMATION**

**VERTIGO®+**

*Rod Hanger Anchor*

**PRODUCT DESCRIPTION**

Vertigo+ is a one piece, all steel threaded fastening system for suspending threaded rod in applications such as pipe hanging, fire protection, electrical conduit and cable-trays. They can be installed in base materials including normal-weight concrete and sand-lightweight concrete over steel deck. Vertigo+ accepts threaded rods and bolts in 1/4", 3/8", and 1/2" diameters. Vertigo+ anchors are designed for simple fast installations and reliable performance in cracked and uncracked concrete.

**GENERAL APPLICATIONS AND USES**

- Hanging Pipe and Sprinkler Systems
- HVAC Ductwork and Strut Channels
- Suspending Conduit and Cable Trays
- Suspended Ceilings
- Lighting Systems and Overhead Utilities

**FEATURES AND BENEFITS**

- + Simple system for all rod hanging applications in concrete
- + Lower in-place cost, when compared to traditional anchors
- + Internally threaded coupler for easy removability of service items
- + Can be installed with an adjustable torque impact driver
- + Ease and speed of installation and attachment
- + Consistent performance in high and low strength concrete

**APPROVALS AND LISTINGS**

- International Code Council, Evaluation Service (ICC-ES). ESR-2526. Code compliant with the 2015 IBC, 2015 IRC, 2012 IBC, 2012 IRC, 2009 IBC, 2009 IRC, 2006 IBC, and 2006 IRC
- Tested in accordance with ACI 355.2 / ASTM E 488 and ICC-ES AC193 for use in structural concrete under the design provisions of ACI 318 (Strength Design method using Appendix D)
- Evaluated and qualified by an accredited independent testing laboratory for recognition in cracked and uncracked concrete including seismic and wind loading (Category 1 anchors)
- Evaluated and qualified by an accredited independent testing laboratory for reliability against brittle failure, e.g. hydrogen embrittlement

**GUIDE SPECIFICATIONS**

CSI Divisions: 03 16 00 - Concrete Anchors and 05 05 19 - Post-Installed Concrete Anchors. Anchors shall be Vertigo+ as supplied by Powers Fasteners, Inc., Brewster, NY. Anchors shall be installed in accordance with published instruction and the Authority Having Jurisdiction.

**SECTION CONTENTS**

General Information..... 1  
 Material Specifications .....2  
 Installation Specifications .....2  
 Installation Instructions .....3  
 Performance Data (ASD).....4  
 Performance Data (SD) .....5  
 Ordering Information .....7



CONCRETE VERTIGO+™

**THREAD VERSION**

Unified course thread (UNC)

**ANCHOR MATERIALS**

- Zinc Plated Carbon Steel (Yellow Dichromate Finish)

**ANCHOR SIZE RANGE (TYP.)**

- 1/4", 3/8" and 1/2" diameters

**SUITABLE BASE MATERIALS**

- Normal-weight concrete
- Sand-lightweight concrete
- Normal-weight concrete over steel deck



This Product Available In



Powers Design Assist®  
 Real-Time Anchor Design Software  
[www.powersdesignassist.com](http://www.powersdesignassist.com)

**MATERIAL SPECIFICATIONS**

Anchor component	Specification
Anchor Body / Coupler Head	Case hardened low carbon steel
Plating	Zinc plating according to ASTM B 633, SC1 Type III (Fe/Zn 5) Minimum plating requirement for Mild Service Condition

**INSTALLATION SPECIFICATIONS**


**Installation Table for Vertigo+**

Anchor Property/ Setting Information	Symbol	Units	Nominal Anchor Size / Threaded Coupler Diameter (in.)		
			1/4	3/8	1/2
Nominal anchor shank diameter	$d_o$	in.	0.375 (9.5)	0.375 (9.5)	0.375 (9.5)
Nominal drill bit diameter	$d_{bit}$	in.	3/8 Wedge-bit	3/8 Wedge-bit	3/8 Wedge-bit
Wedge-bit tolerance range	-	in.	0.385 to 0.389	0.385 to 0.389	0.385 to 0.389
Nominal embedment depth	$h_{nom}$	in. (mm)	2-1/8 (50.8)	2-1/8 (50.8)	2-1/8 (50.8)
Effective embedment	$h_{ef}$	in. (mm)	1.425 (36)	1.425 (36)	1.425 (36)
Minimum hole depth	$h_o$	in. (mm)	2-1/2 (64)	2-1/2 (64)	2-1/2 (64)
Minimum member thickness <sup>1,2</sup>	$h_{min}$	in. (mm)	4 (102)	4 (102)	4 (102)
Overall anchor length	$l_{anch}$	in. (mm)	3 (76)	3 (76)	3 (76)
Minimum edge distance <sup>1,2</sup>	$c_{min}$	in. (mm)	1-3/4 (44)	1-3/4 (44)	1-3/4 (44)
Minimum spacing distance <sup>1,2</sup>	$s_{min}$	in. (mm)	2-1/2 (64)	2-1/2 (64)	2-1/2 (64)
Critical edge distance <sup>1,2</sup>	$c_{ac}$	in. (mm)	2-3/4 (70)	2-3/4 (70)	2-3/4 (70)
Maximum impact wrench power (torque)	$T_{screw}$	ft.-lb. (N-m)	185 (250)	185 (250)	185 (250)
Impact wrench / socket size	$d_h$	in.	11/16	11/16	11/16
Head height	-	in.	3/4	3/4	3/4

For SI: 1 inch = 25.4 mm,

- 1 ft-lbf = 1.356 N-m
2. For installations through the soffit of steel deck into concrete, see the installation detail. Anchors in the lower flute may be installed with a maximum 1-inch offset in either direction from center of the flute. In addition, anchors shall have an axial spacing along the flute equal to the greater of  $3h_{ef}$  or 1.5 times the flute width.
3. For use with the design provisions of ACI 318 Appendix D.

**Vertigo+ Anchor Detail in Concrete**

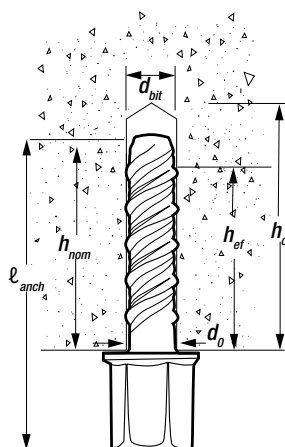

**Hex Coupler Heads**




**Matched Tolerance System**




Designed and tested as a system for consistency and reliability


**INSTALLATION INSTRUCTIONS**




**Step 1**  
Using the proper Wedge-bit size, drill a hole into the base material to the required depth. The tolerances of the Wedge-bit used must meet the requirements of the published Wedge-bit range



**Step 2**  
Remove dust and debris from the hole.




**Step 3**  
Select a powered impact wrench that does not exceed the maximum torque,  $T_{screw}$ , for the selected anchor diameter. Attach an appropriate sized hex socket/driver to the impact wrench. Mount the screw anchor head into the socket.




**Step 4**  
Drive the anchor into the hole until the head of the anchor comes into contact with the member surface. The anchor should be snug after installation. Do not spin the hex socket off the anchor to disengage. Insert threaded rod or bolt into Vertigo+.

**INSTALLATION DETAIL FOR VERTIGO+ INSTALLED THROUGH SOFFIT OR STEEL DECK INTO CONCRETE**

SAND-LIGHTWEIGHT CONCRETE OR NORMAL WEIGHT CONCRETE OVER STEEL DECK (MINIMUM 3,000 PSI)

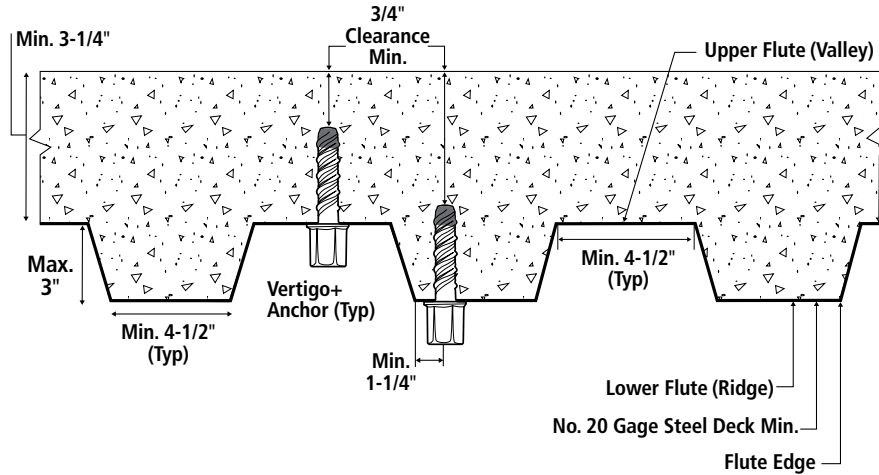

SAND-LIGHTWEIGHT CONCRETE OR NORMAL WEIGHT CONCRETE OVER STEEL DECK (MINIMUM 3,000 PSI)

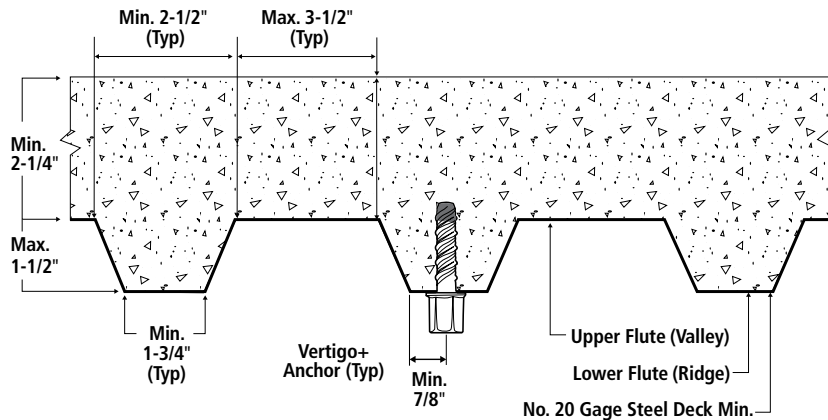

**PERFORMANCE DATA (ASD)**

**Ultimate Load Capacities for Vertigo+ in Normal-Weight Concrete<sup>1,2</sup>**

Nominal Anchor Size / Threaded Coupler Diameter in. (mm)	Nominal Anchor Shank Diameter d <sub>o</sub> in. (mm)	Minimum Embedment Depth h <sub>nom</sub> in. (mm)	Minimum Concrete Compressive Strength f' <sub>c</sub>							
			2,500 psi (17.2 MPa)		3,000 psi (20.7 MPa)		4,000 psi (27.6 MPa)		6,000 psi (41.4 MPa)	
			Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)
1/4 (6.3)	3/8 (9.5)	2-1/8 (54.0)	3,260 (14.5)	2,850 (12.7)	3,570 (15.9)	2,850 (12.7)	4,205 (18.8)	2,850 (12.7)	5,150 (23.0)	2,850 (12.7)
3/8 (9.5)	3/8 (9.5)	2-1/8 (54.0)	3,260 (14.5)	4,235 (18.9)	3,570 (15.9)	4,235 (18.9)	4,205 (18.8)	4,235 (18.9)	5,150 (23.0)	4,235 (18.9)
1/2 (12.7)	3/8 (9.5)	2-1/8 (54.0)	3,260 (14.5)	4,235 (18.9)	3,570 (15.9)	4,235 (18.9)	4,205 (18.8)	4,235 (18.9)	5,150 (23.0)	4,235 (18.9)

1. Tabulated load values are for anchors installed in concrete. Concrete compressive strength must be at the specified minimum at the time of installation.  
2. Ultimate load capacities must be reduced by a minimum safety factor of 4.0 or greater to determine allowable working load.

**Allowable Load Capacities for Vertigo+ in Normal-Weight Concrete<sup>1</sup>**



Nominal Anchor Size / Threaded Coupler Diameter in. (mm)	Nominal Anchor Shank Diameter d <sub>o</sub> in. (mm)	Minimum Embedment Depth h <sub>nom</sub> in. (mm)	Minimum Concrete Compressive Strength f' <sub>c</sub>							
			2,500 psi (17.2 MPa)		3,000 psi (20.7 MPa)		4,000 psi (27.6 MPa)		6,000 psi (41.4 MPa)	
			Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)	Tension lbs. (kN)	Shear lbs. (kN)
1/4 (6.3)	3/8 (9.5)	2-1/8 (54.0)	815 (3.6)	485 (2.2)	890 (4.0)	485 (2.2)	1,050 (4.7)	485 (2.2)	1,290 (5.7)	485 (2.2)
3/8 (9.5)	3/8 (9.5)	2-1/8 (54.0)	815 (3.6)	1,060 (4.7)	890 (4.0)	1,060 (4.7)	1,050 (4.7)	1,060 (4.7)	1,290 (5.7)	1,060 (4.7)
1/2 (12.7)	3/8 (9.5)	2-1/8 (54.0)	815 (3.6)	1,060 (4.7)	890 (4.0)	1,060 (4.7)	1,050 (4.7)	1,060 (4.7)	1,290 (5.7)	1,060 (4.7)

1. Allowable load capacities are calculated using an applied safety factor of 4.0.

**MECHANICAL ANCHORS**

**VERTIGO® +**  
Rod Hanger Anchor

**PERFORMANCE DATA (SD)**

**Tension Design Information For Vertigo+ Anchors in Concrete**  
**(For use with load combinations taken from ACI 318 Section 9.2)<sup>1,2</sup>**



Design Characteristic	Notation	Units	Nominal Anchor Size / Threaded Coupler Diameter (in.)		
			1/4"	3/8"	1/2"
Anchor category	1, 2 or 3	-	1	1	1
Nominal embedment depth	$h_{nom}$	in.	2-1/8	2-1/8	2-1/8
<b>STEEL STRENGTH IN TENSION<sup>4</sup></b>					
Minimum specified yield strength of steel insert element (threaded rod or bolt)	$f_y$	ksi (N/mm <sup>2</sup> )	36.0 (248)	36.0 (248)	36.0 (248)
Minimum specified ultimate strength of steel insert element (threaded rod or bolt)	$f_{uta}^{11}$	ksi (N/mm <sup>2</sup> )	58.0 (400)	58.0 (400)	58.0 (400)
Effective tensile stress area of steel insert element (threaded rod or bolt)	$A_{se,N} [A_{se}]^{12}$	in <sup>2</sup> (mm <sup>2</sup> )	0.0318 (20.5)	0.0775 (50)	0.1419 (91.6)
Steel strength in tension	$N_{sa}^{11}$	lb (kN)	1,845 (8.2)	4,495 (20)	8,230 (36.6)
Reduction factor for steel strength <sup>3</sup>	$\phi$	-	0.65	0.65	0.65
<b>CONCRETE BREAKOUT IN TENSION<sup>5</sup></b>					
Effective embedment	$h_{ef}$	in. (mm)	1.425 (36)	1.425 (36)	1.425 (36)
Effectiveness factor for uncracked concrete	$k_{uncr}$	-	24	24	24
Effectiveness factor for cracked concrete	$k_{cr}$	-	17	17	17
Modification factor for cracked and uncracked concrete <sup>5</sup>	$\psi_{c,N}^{11}$	-	1 See note 5	1 See note 5	1 See note 5
Critical edge distance	$c_{ac}$	in. (mm)	2-3/4 (70)	2-3/4 (70)	2-3/4 (70)
Reduction factor for concrete breakout strength <sup>3</sup>	$\phi$	-	0.65 (Condition B)		
<b>PULLOUT STRENGTH IN TENSION (NON-SEISMIC APPLICATIONS)<sup>6</sup></b>					
Characteristic pullout strength, uncracked concrete (2,500 psi) <sup>6</sup>	$N_{p,uncr}$	lb (kN)	See note 7	See note 7	See note 7
Characteristic pullout strength, cracked concrete (2,500 psi) <sup>6</sup>	$N_{p,cr}$	lb (kN)	See note 7	See note 7	See note 7
Reduction factor for pullout strength <sup>3</sup>	$\phi$	-	0.65 (Condition B)		
<b>PULLOUT STRENGTH IN TENSION FOR SEISMIC APPLICATIONS<sup>8</sup></b>					
Characteristic pullout strength, seismic (2,500 psi) <sup>6,9</sup>	$N_{p,eq}^{11}$	lb (kN)	1,085 (4.8)	1,085 (4.8)	1,085 (4.8)
Reduction factor for pullout strength <sup>3</sup>	$\phi$	-	0.65 (Condition B)		
<b>PULLOUT STRENGTH IN TENSION FOR STRUCTURAL SAND-LIGHTWEIGHT AND NORMAL-WEIGHT CONCRETE OVER STEEL DECK</b>					
Characteristic pullout strength, uncracked concrete over steel deck <sup>6,10</sup>	$N_{p,deck,uncr}$	lb (kN)	1,905 (8.5)	1,990 (8.9)	1,990 (8.9)
Characteristic pullout strength, cracked concrete over steel deck <sup>6,10</sup>	$N_{p,deck,cr}$	lb (kN)	1,350 (6.0)	1,410 (6.3)	1,410 (6.3)
Characteristic pullout strength, cracked concrete over steel deck seismic <sup>6,10</sup>	$N_{p,deck,eq}$	lb (kN)	1,015 (4.5)	1,060 (4.7)	1,060 (4.7)
Reduction factor for pullout strength <sup>3</sup>	$\phi$	-	0.65		

- The data in this table is intended to be used with the design provisions of ACI 318 Appendix D; for anchors resisting seismic load combinations the additional requirements of ACI 318 D.3.3 must apply.
- Installation must comply with printed instructions.
- All values of  $\phi$  were determined from the load combinations of UBC Section 1605.2.1, UBC Section 1612.2.1, or ACI 318 Section 9.2. If the load combinations of UBC Section 1902.2 or ACI 318 Appendix C are used, the appropriate value of  $\phi$  must be determined in accordance with ACI 318 D.4.5. For reinforcement that meets ACI 318 Appendix D requirements for Condition A, see ACI 318 D.4.4 for the appropriate  $\phi$  factor.
- It is assumed that the threaded rod or bolt used with the Vertigo+ anchor will be a ductile steel element as defined by ACI 318 D.1.
- For all design cases use  $\psi_{c,N} = 1.0$ . The appropriate effectiveness factor for cracked concrete ( $k_{cr}$ ) and uncracked concrete ( $k_{uncr}$ ) must be selected.
- For all design cases use  $\psi_{cp} = 1.0$ . For concrete compressive strength greater than 2,500 psi,  $N_{pn} = (\text{Pullout strength value from table}) \times (\text{specified concrete compressive strength} / f'_{c,min})^{0.5}$  where the value of  $f'_{c,min}$  is 2500 except in concrete over steel deck where the value of  $f'_{c,min}$  is 3000.
- Pullout strength does not control design of indicated anchors. Do not calculate pullout strength for indicated anchor size and embedment.
- Anchors are permitted to be used in structural sand-lightweight concrete provided that  $N_b$ ,  $N_{eq}$  and  $N_{pn}$  are multiplied by a factor of 0.60 (not required for steel deck).
- Tabulated values for characteristic pullout strength in tension are for seismic applications and based on test results in accordance with ACI 355.2, Section 9.5.
- Values for  $N_{p,deck}$  are for structural sand-lightweight concrete ( $f'_{c,min} = 3,000$  psi) and additional lightweight concrete reduction factors need not be applied. In addition, evaluation for the concrete breakout capacity in accordance with ACI 318 D.5.2 is not required for anchors installed in the flute (soffit).
- For 2003 IBC,  $f_{uta}$  replaces  $f_{ut}$ ;  $N_{sa}$  replaces  $N_t$ ;  $\psi_{c,N}$  replaces  $\psi_s$ ; and  $N_{p,eq}$  replaces  $N_{p,seis}$ .
- The notation in brackets is for the 2006 IBC.

**MECHANICAL ANCHORS**

**VERTIGO+<sup>®</sup>**  
Rod Hanger Anchor



**Shear Design Information For Vertigo+ Anchors in Concrete**  
(For use with load combinations taken from ACI 318 Section 9.2)<sup>1,2</sup>


Design Characteristic	Notation	Units	Nominal Anchor Size / Threaded Coupler Diameter (in.)		
			1/4"	3/8"	1/2"
Anchor category	1, 2 or 3	-	1	1	1
Nominal embedment depth	$h_{nom}$	in.	2-1/8	2-1/8	2-1/8
<b>STEEL STRENGTH IN SHEAR<sup>5</sup></b>					
Steel strength in shear <sup>3</sup>	$V_{sa}^{10}$	lb (kN)	1,105 (4.9)	2,695 (12)	3,075 (13.7)
Reduction factor for steel strength <sup>3</sup>	$\phi$	-	0.60	0.60	0.60
<b>CONCRETE BREAKOUT IN SHEAR<sup>6</sup></b>					
Load bearing length of anchor ( $h_{ef}$ or $8d_o$ , whichever is less)	$\ell_e^{10}$	in. (mm)	1.425 (36)	1.425 (36)	1.425 (36)
Nominal anchor diameter	$d_a [d_o]^{11}$	in. (mm)	0.375 (9.5)	0.375 (9.5)	0.375 (9.5)
Reduction factor for concrete breakout strength <sup>3</sup>	$\phi$	-	0.70 (Condition B)		
<b>PRYOUT STRENGTH IN SHEAR<sup>6</sup></b>					
Coefficient for prout strength (1.0 for $h_{ef} < 2.5$ in, 2.0 for $h_{ef} \geq 2.5$ in)	$k_{cp}$	-	1	1	1
Reduction factor for prout strength <sup>3</sup>	$\phi$	-	0.70 (Condition B)		
<b>STEEL STRENGTH IN SHEAR FOR SEISMIC APPLICATIONS</b>					
Steel strength in shear, seismic <sup>7</sup>	$V_{eq}^{10}$	lb (kN)	1,105 (4.9)	2,000 (8.9)	2,000 (8.9)
Reduction factor for steel strength in shear for seismic applications <sup>3</sup>	$\phi$	-	0.60	0.60	0.60
<b>STEEL STRENGTH IN SHEAR FOR STRUCTURAL SAND-LIGHTWEIGHT AND NORMAL-WEIGHT CONCRETE OVER STEEL DECK<sup>8</sup></b>					
Steel strength in shear, concrete over steel deck <sup>8</sup> , according to top figure <sup>12</sup>	$V_{sa,deck}$	lb (kN)	1,105 (4.9)	1,975 (8.8)	2,495 (11.1)
Steel strength in shear, concrete over steel deck seismic <sup>8</sup> , according to top figure <sup>12</sup>	$V_{sa,deck,eq}$	lb (kN)	1,105 (4.9)	1,480 (6.6)	1,620 (7.2)
Steel strength shear, concrete over steel deck, according to bottom figure <sup>8,12</sup>	$V_{sa,deck}$	lb (kN)	965 (4.3)		
Steel strength shear, concrete over steel deck, seismic, according to bottom figure <sup>8,12</sup>	$V_{sa,deck,eq}$	lb (kN)	965 (4.3)		
Reduction factor for steel strength in shear for steel deck applications <sup>3</sup>	$\phi$	-	0.60	0.60	0.60

For Sl: 1 inch = 25.4 mm

- The data in this table is intended to be used with the design provisions of ACI 318 Appendix D; for anchors resisting seismic load combinations the additional requirements of ACI 318 D.3.3 shall apply.
- Installation must comply with published instructions and details.
- All values of  $\phi$  were determined from the load combinations of UBC Section 1605.2.1, UBC Section 1612.2.1, or ACI 318 Section 9.2. If the load combinations of UBC Section 1902.2 or ACI 318 Appendix C are used, the appropriate value of  $\phi$  must be determined in accordance with ACI 318 D.4.5. For reinforcement that meets ACI 318 Appendix D requirements for Condition A, see ACI 318 D.4.4 for the appropriate  $\phi$  factor.
- It is assumed that the threaded rod or bolt used with the Vertigo+ anchor will be a ductile steel element as defined by ACI 318 D.1.
- Tabulated values for steel strength in shear must be used for design. These tabulated values are lower than calculated results using equation D-20 in ACI 318-05 D.6.1.2 and D-18 in ACI 318-02, D.6.1.2.
- Anchors are permitted to be used in structural sand-lightweight concrete provided that  $V_b$  and  $V_{cp}$  are multiplied by a factor of 0.60 (not required for steel deck).
- Reported values for steel strength in shear for seismic applications are based on test results per ACI 355.2 Section 9.6.
- Values for  $V_{sa,deck}$  are for structural sand-lightweight concrete ( $f'_{cmin} = 3,000$  psi) and additional lightweight concrete reduction factors need not be applied. In addition, evaluation for the concrete breakout capacity in accordance with ACI 318 D.6.2 and the prout capacity in accordance with ACI 318 D.6.3 are not required for anchors installed in the flute (soffit).
- Shear loads for anchors installed through steel deck into concrete may be applied in any direction.
- For 2003 IBC,  $f_{uta}$  replaces  $f_u$ ;  $V_{sa}$  replaces  $V_s$ ;  $\ell_e$  replaces  $\ell$ ; and  $V_{eq}$  replaces  $V_{seis}$ .
- The notation in brackets is for the 2006 IBC.
- See installation details.

**Factored Resistance Strength ( $\phi N_n$  And  $\phi V_n$ ) Calculated In Accordance With ACI 318 Appendix D:**

- Tabular values are provided for illustration and are applicable for single anchors installed in normal-weight concrete with minimum slab thickness,  $h_a = h_{min}$ , and with the following conditions:
  - $C_{a1}$  is greater than or equal to the critical edge distance,  $C_{ac}$  (table values based on  $C_{a1} = C_{ac}$ ).
  - $C_{a2}$  is greater than or equal to 1.5 times  $C_{a1}$ .
- Calculations were performed according to ACI 318-11 Appendix D. The load level corresponding to the controlling failure mode is listed. (e.g. For tension: steel, concrete breakout and pullout; For shear: steel, concrete breakout and pryout). Furthermore, the capacities for concrete breakout strength in tension and pryout strength in shear are calculated using the effective embedment values,  $h_{ef}$ , for the selected anchors as noted in the design information tables. Please also reference the installation specifications for more information.
- Strength reduction factors ( $\phi$ ) were based on ACI 318 Section 9.2 for load combinations. Condition B is assumed.
- Tabular values are permitted for static loads only, seismic loading is not considered with these tables.
- For designs that include combined tension and shear, the interaction of tension and shear loads must be calculated in accordance with ACI 318 Appendix D.
- Interpolation is not permitted to be used with the tabular values. For intermediate base material compressive strengths please see ACI 318 Appendix D. For other design conditions including seismic considerations please see ACI 318 Appendix D.

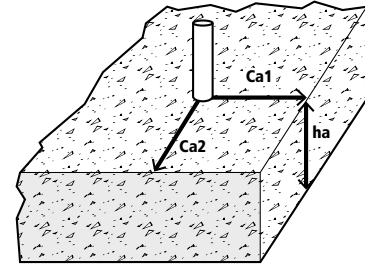

**Tension and Shear Design Strength Cracked Concrete**



Nominal Anchor Size (in.)	Nominal Embed. $h_{nom}$ (in.)	Minimum Concrete Compressive Strength, $f'_c$ (psi)									
		2,500		3,000		4,000		6,000		8,000	
		$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)
1/4	2-1/8	940	665	1,030	665	1,190	665	1,200	665	1,200	665
3/8	2-1/8	940	880	1,030	965	1,190	1,115	1,455	1,365	1,680	1,575
1/2	2-1/8	940	880	1,030	965	1,190	1,115	1,455	1,365	1,680	1,575

■ - Anchor Pullout/Pryout Strength Controls 
 ■ - Concrete Breakout Strength Controls 
 ■ - Steel Strength Controls

**Tension and Shear Design Strength Uncracked Concrete**



Nominal Anchor Size (in.)	Nominal Embed. $h_{nom}$ (in.)	Minimum Concrete Compressive Strength, $f'_c$ (psi)									
		2,500		3,000		4,000		6,000		8,000	
		$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)	$\phi N_n$ Tension (lbs.)	$\phi V_n$ Shear (lbs.)
1/4	2-1/8	1,200	665	1,200	665	1,200	665	1,200	665	1,200	665
3/8	2-1/8	1,325	1,230	1,455	1,350	1,680	1,560	2,055	1,615	2,375	1,615
1/2	2-1/8	1,325	1,230	1,455	1,350	1,680	1,560	2,055	1,845	2,375	1,845


■ - Anchor Pullout/Pryout Strength Controls 
 ■ - Concrete Breakout Strength Controls 
 ■ - Steel Strength Controls

**ORDERING INFORMATION**

**Vertigo+ Rod Hanger (Carbon Steel w/Blue Tip)**

Cat. No.	Rod Dia.	Screw Shank Size and Length	Thread Style	Pre-Drill Diameter	Std. Box	Std. Ctn.
7180SD	1/4"	3/8" x 2-1/8"	Wedge-Bolt+	3/8" Wedge-Bit	50	250
7181SD	3/8"					
7182SD	1/2"					

An SDS 3/8" x 6" Wedge-Bit is included in each box of Vertigo+

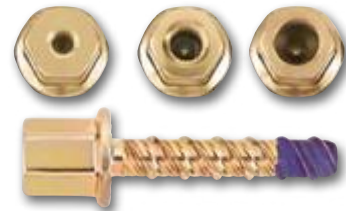

**Wedge-Bit**

Cat. No.	Wedge-Bit Description	Usable Length	Std. Box	Std. Ctn.
01316	SDS 3/8" x 6"	4"	1	1
01380	HD Straight Shank 3/8" x 6"	4"	5	25

